

IADC

**IADC
ISP PROGRAM**

2018



**Summary of Occupational
Incidents
(Africa Water Totals)**

Issued 15 June 2019

Table of Contents

(Table of Contents is Hyperlinked, Just click on Topic & go)


IADC 2018 AFRICA WATER TOTALS (TABLE 1).....	1
<i>Africa Water Total Incidence Rates vs Man-hours (Figure 1).....</i>	<i>1</i>
IADC 2018 AFRICA WATER CHARTS	2
<i>Africa Water Total Recordable Incidents by Month (Chart 1).....</i>	<i>2</i>
<i>Africa Water Total Recordable Incidents by Occupation (Chart 2).....</i>	<i>3</i>
<i>Africa Water Total Recordable Incidents by Body Part (Chart 3).....</i>	<i>4</i>
<i>Africa Water Total Recordable Incidents by Incident Type (Chart 4).....</i>	<i>5</i>
<i>Africa Water Total Recordable Incidents by Equipment (Chart 5).....</i>	<i>6</i>
<i>Africa Water Total Recordable Incidents by Operation (Chart 6).....</i>	<i>7</i>
<i>Africa Water Total Recordable Incidents by Location (Chart 7).....</i>	<i>8</i>
<i>Africa Water Total Recordable Incidents by Time in Service (Chart 8).....</i>	<i>9</i>
<i>Africa Water Total Recordable Incidents by Time of Day (Chart 9).....</i>	<i>10</i>
<i>Africa Water Total Recordable Incidents by Age (Chart 10).....</i>	<i>11</i>

IADC 2018 Africa Water Totals (Table 1)

	<u>Totals</u>
Total Manhours	12,926,329
Total Medical Treatment Incidents	7
Total Restricted Work Incidents	17
Total Lost Time Incidents	4
Total Fatalities	0
Total Recordables	28
MTO Incidence Rate	0.11
RWC Incidence Rate	0.26
LTI Incidence Rate	0.06
LTI Frequency Rate	0.31
DART Incidence Rate	0.32
DART Frequency Rate	1.62
Recordable Incidence Rate	0.43
Recordable Frequency Rate	2.17

MEDICAL TREATMENT INCIDENCE RATE = MTOs X 200,000 / MANHOURS (LTIs NOT INCLUDED)
 RESTRICTED WORK INCIDENCE RATE = RWCs X 200,000 / MANHOURS (LTIs NOT INCLUDED)
 LOST TIME INCIDENCE RATE = (LTIs+FTLs) X 200,000 / MANHOURS
 LOST TIME FREQUENCY RATE = (LTIs+FTLs) X 1,000,000 / MANHOURS
 DART INCIDENCE RATE = (LTIs+FTLs+RWCs) X 200,000 / MANHOURS
 DART FREQUENCY RATE = (LTIs+FTLs+RWCs) X 1,000,000 / MANHOURS
 RECORDABLE INCIDENCE RATE = RECORDABLES X 200,000 / MANHOURS
 RECORDABLE FREQUENCY RATE = RECORDABLES X 1,000,000 / MANHOURS
Companies Reporting: Water – 19

Africa Water Total Incidence Rates vs Man-hours (Figure 1)

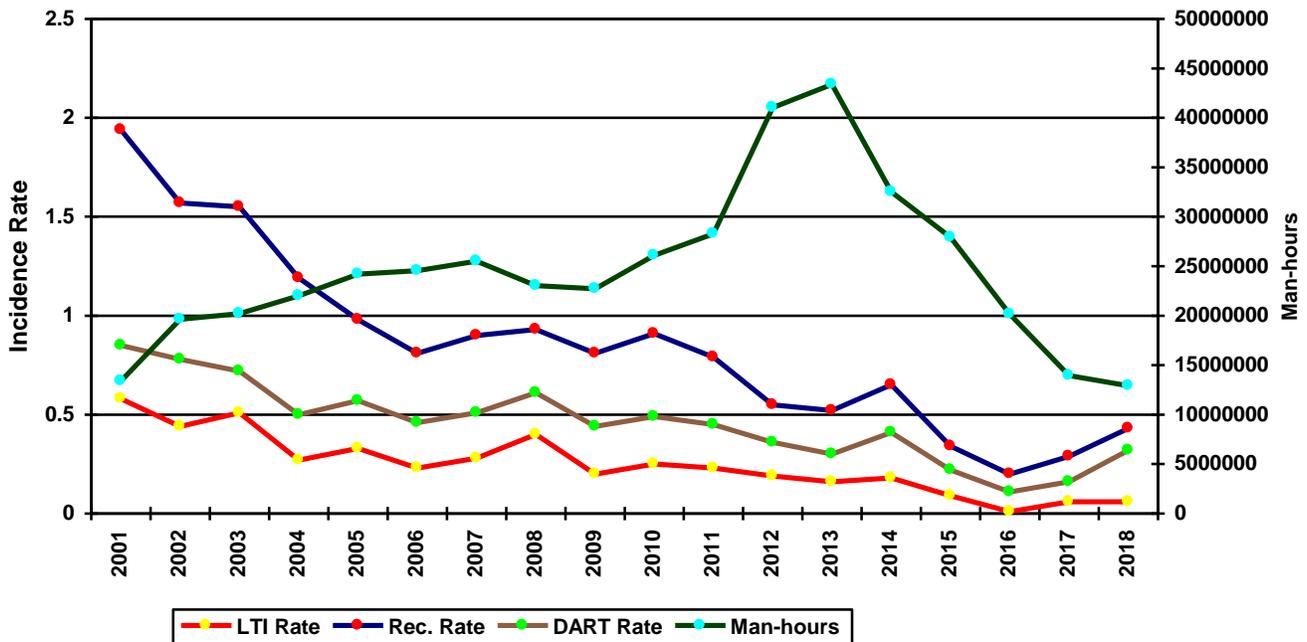


IADC 2018 Africa Water Charts


Note: There were only four Lost Time Incident recorded for 2018, therefore there will not be any charts.

Africa Water Total Recordable Incidents by Month (Chart 1)


Based on 28 Incidents

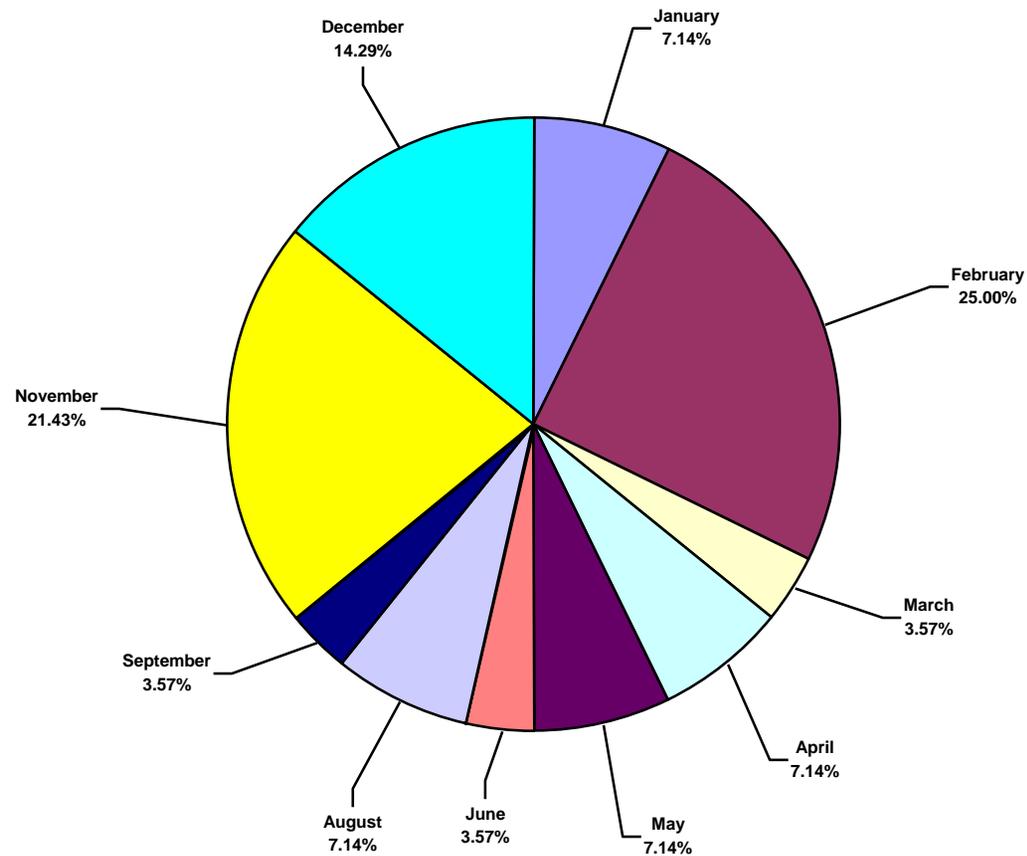


Africa Water Total Recordable Incidents by Occupation (Chart 2)
Based on 28 Incidents

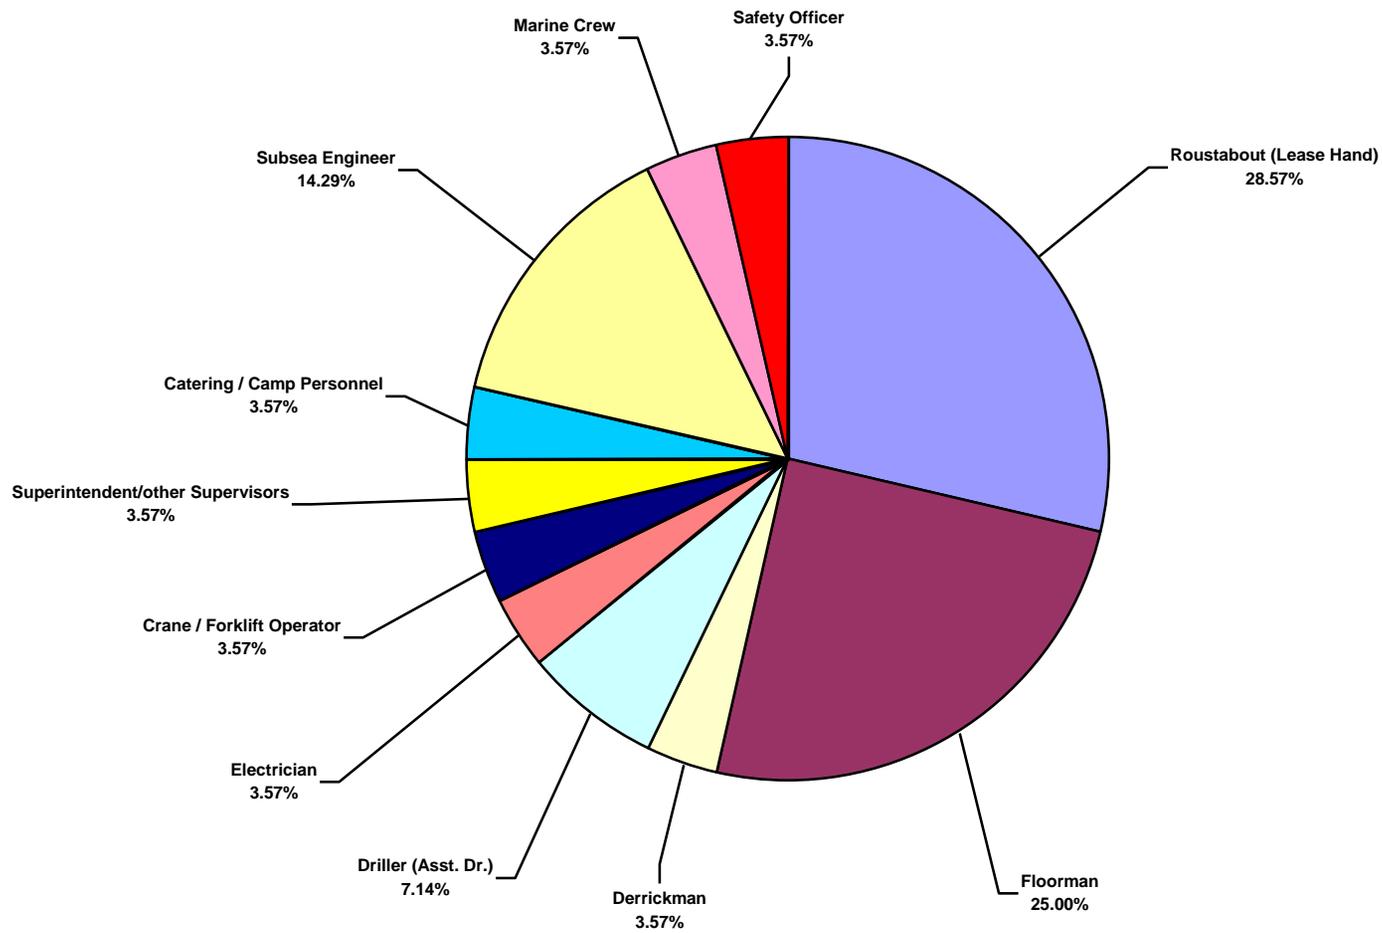


Africa Water Total Recordable Incidents by Body Part (Chart 3)
Based on 28 Incidents

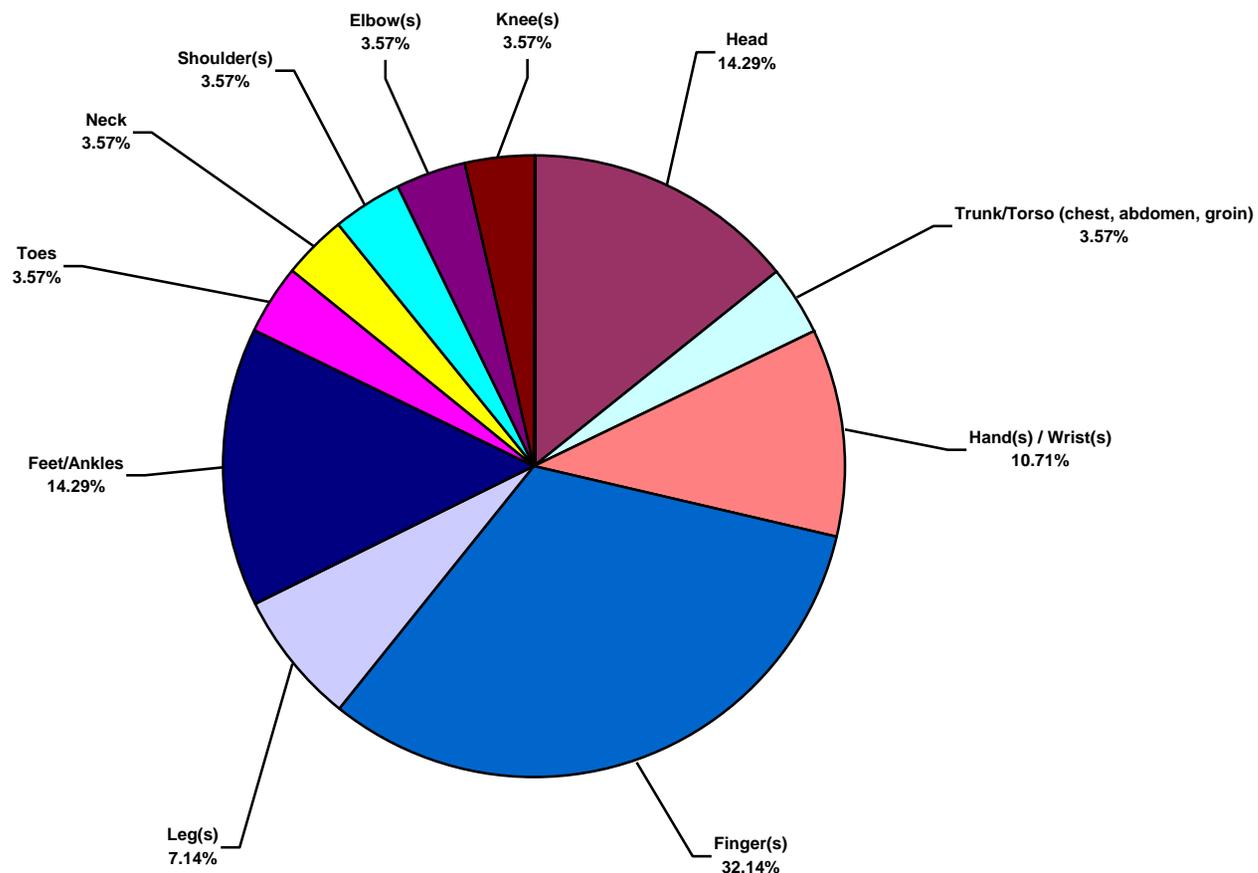


Africa Water Total Recordable Incidents by Incident Type (Chart 4)
Based on 27 Incidents

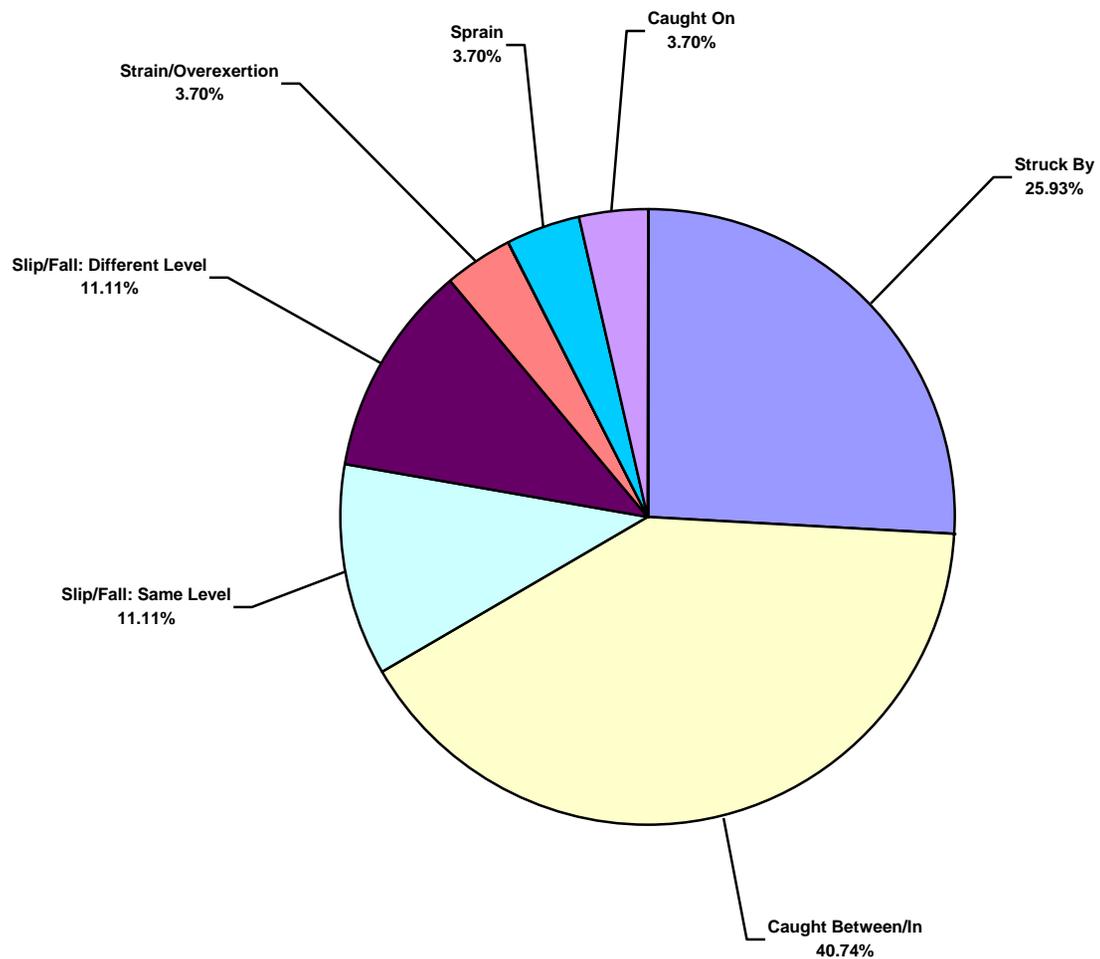


Africa Water Total Recordable Incidents by Equipment (Chart 5)
Based on 24 Incidents

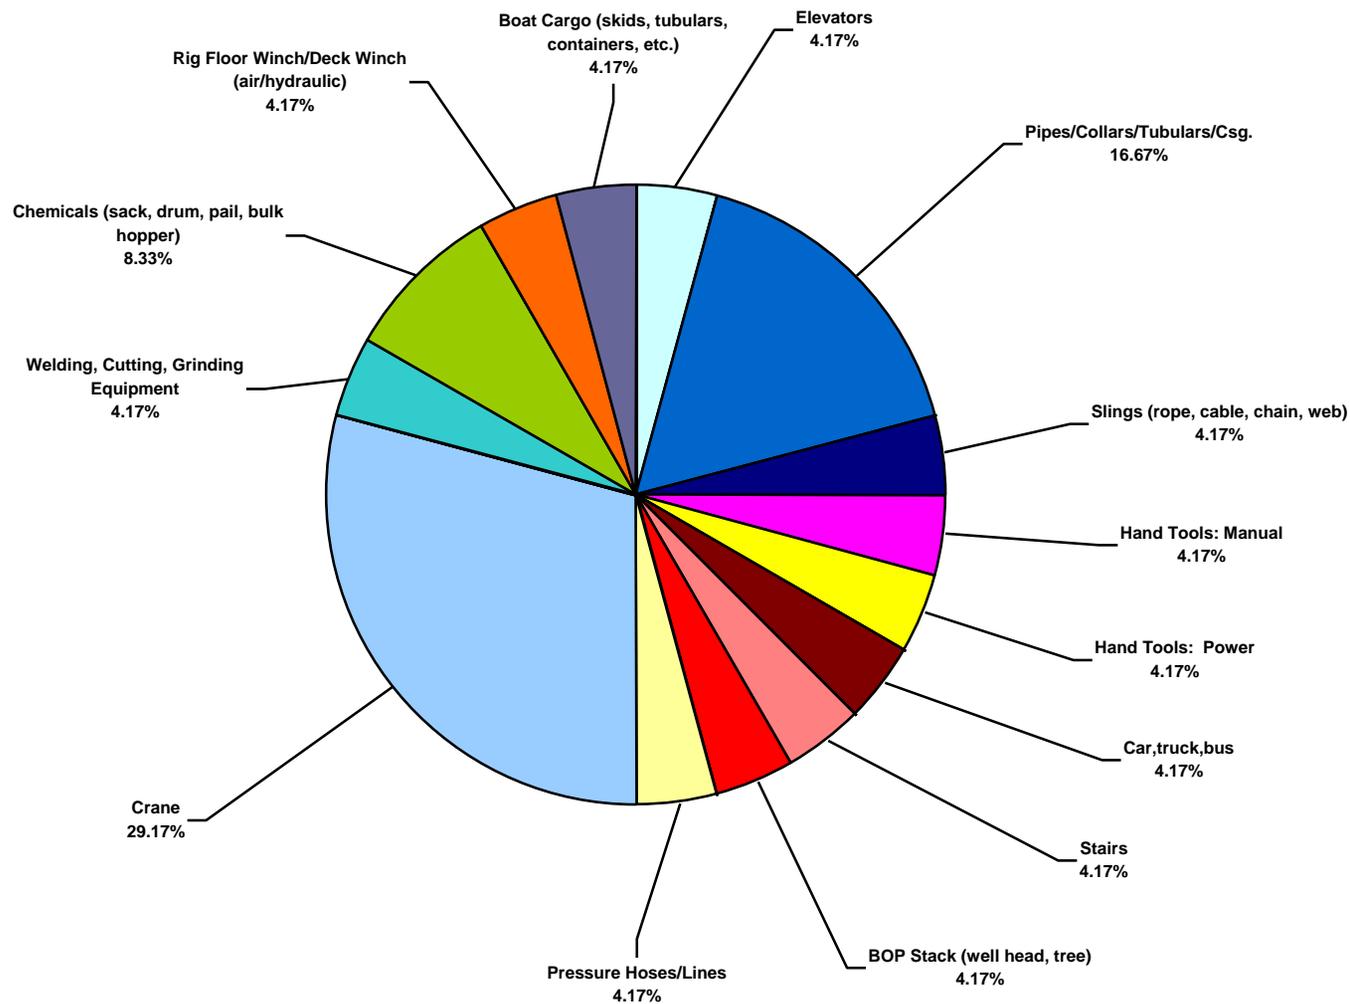


Africa Water Total Recordable Incidents by Operation (Chart 6)
Based on 27 Incidents

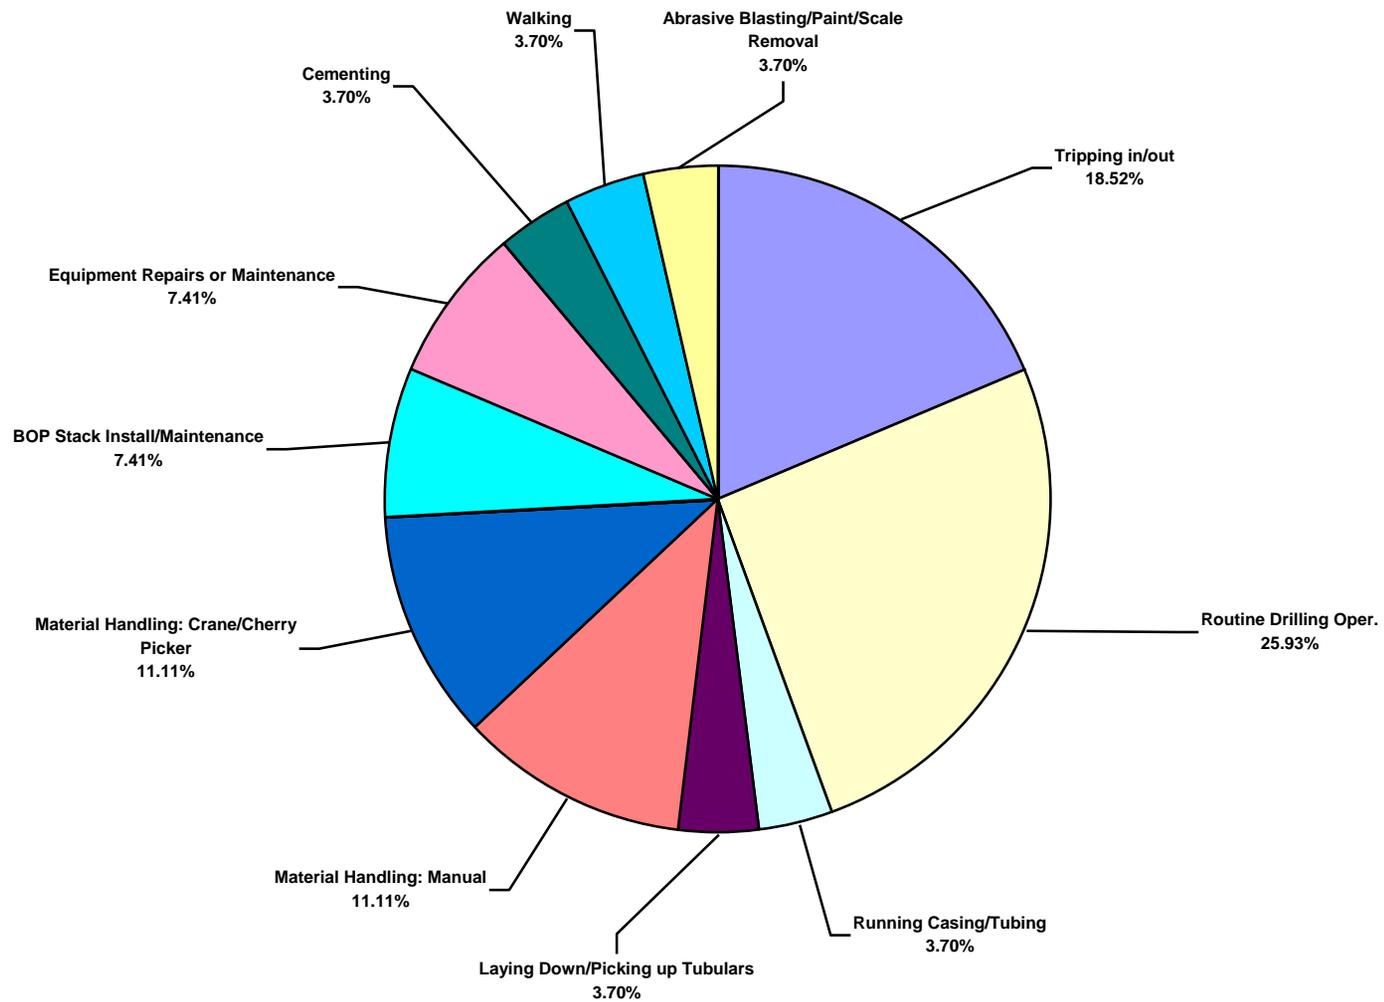


Africa Water Total Recordable Incidents by Location (Chart 7)
Based on 26 Incidents

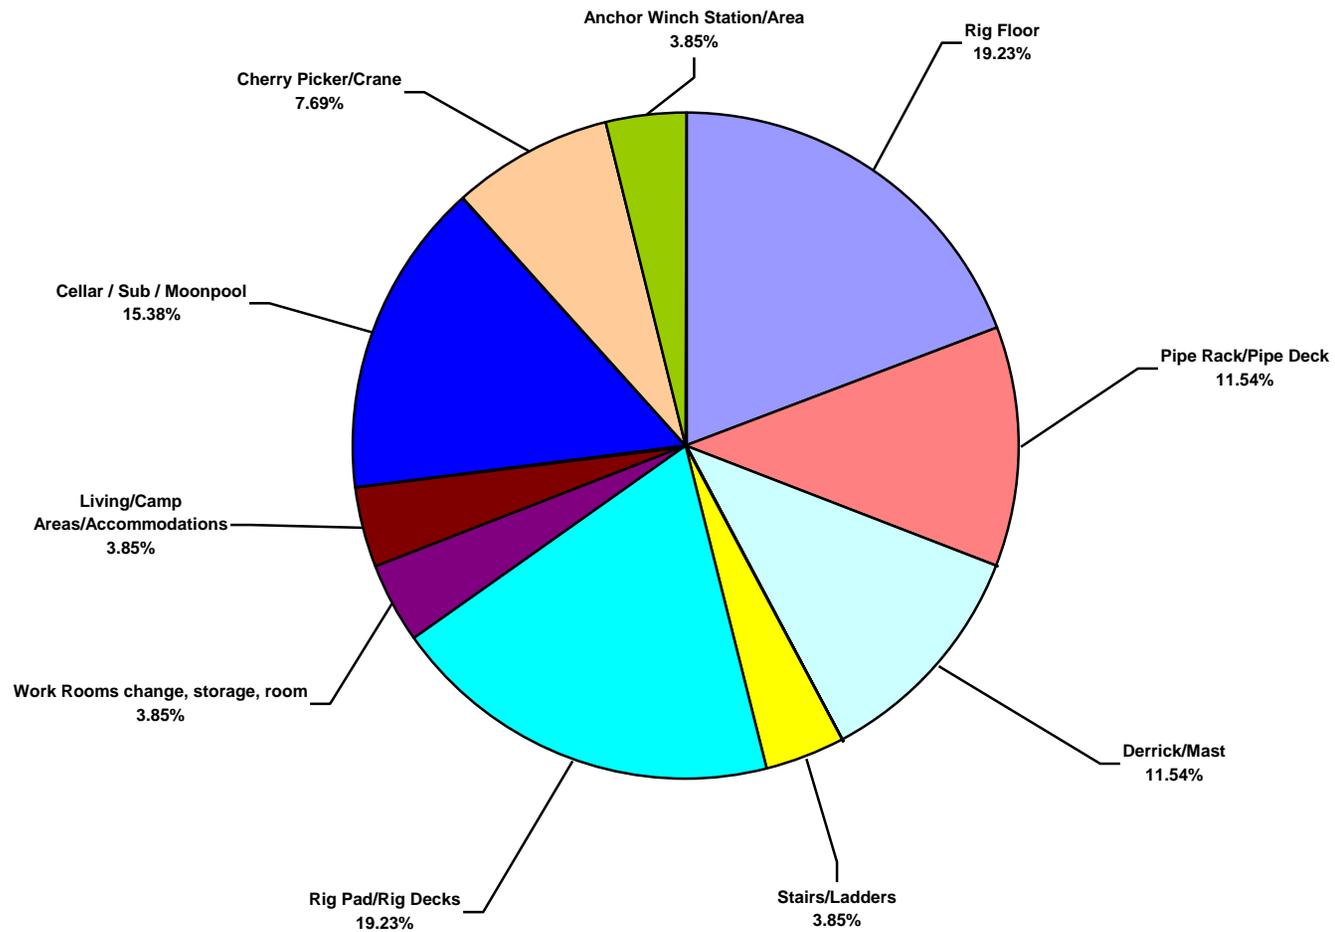

Africa Water Total Recordable Incidents by Time in Service (Chart 8)
Based on 23 Incidents

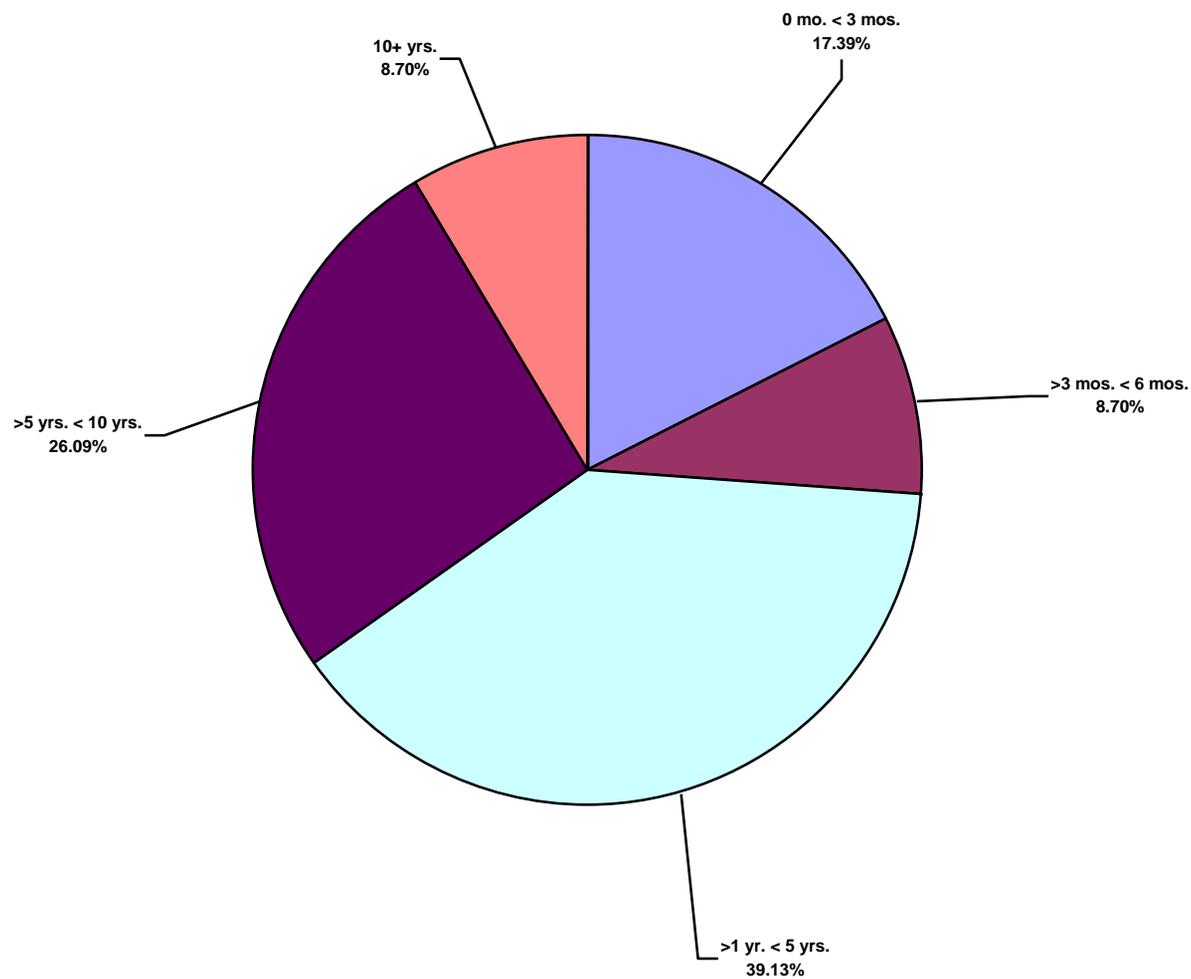

Africa Water Total Recordable Incidents by Time of Day (Chart 9)
Based on 26 Incidents

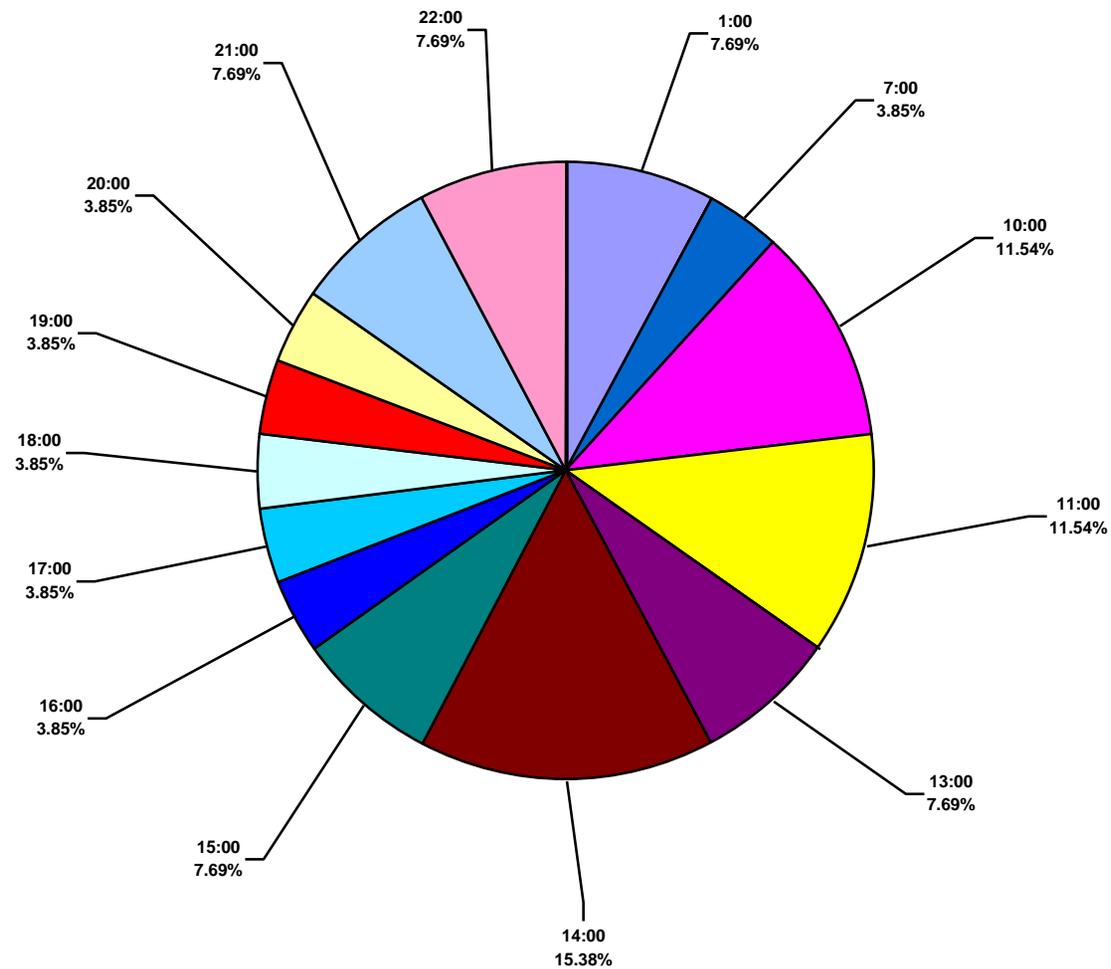

Africa Water Total Recordable Incidents by Age (Chart 10)
Based on 21 Incidents

